


SCALE: 1" = 100'

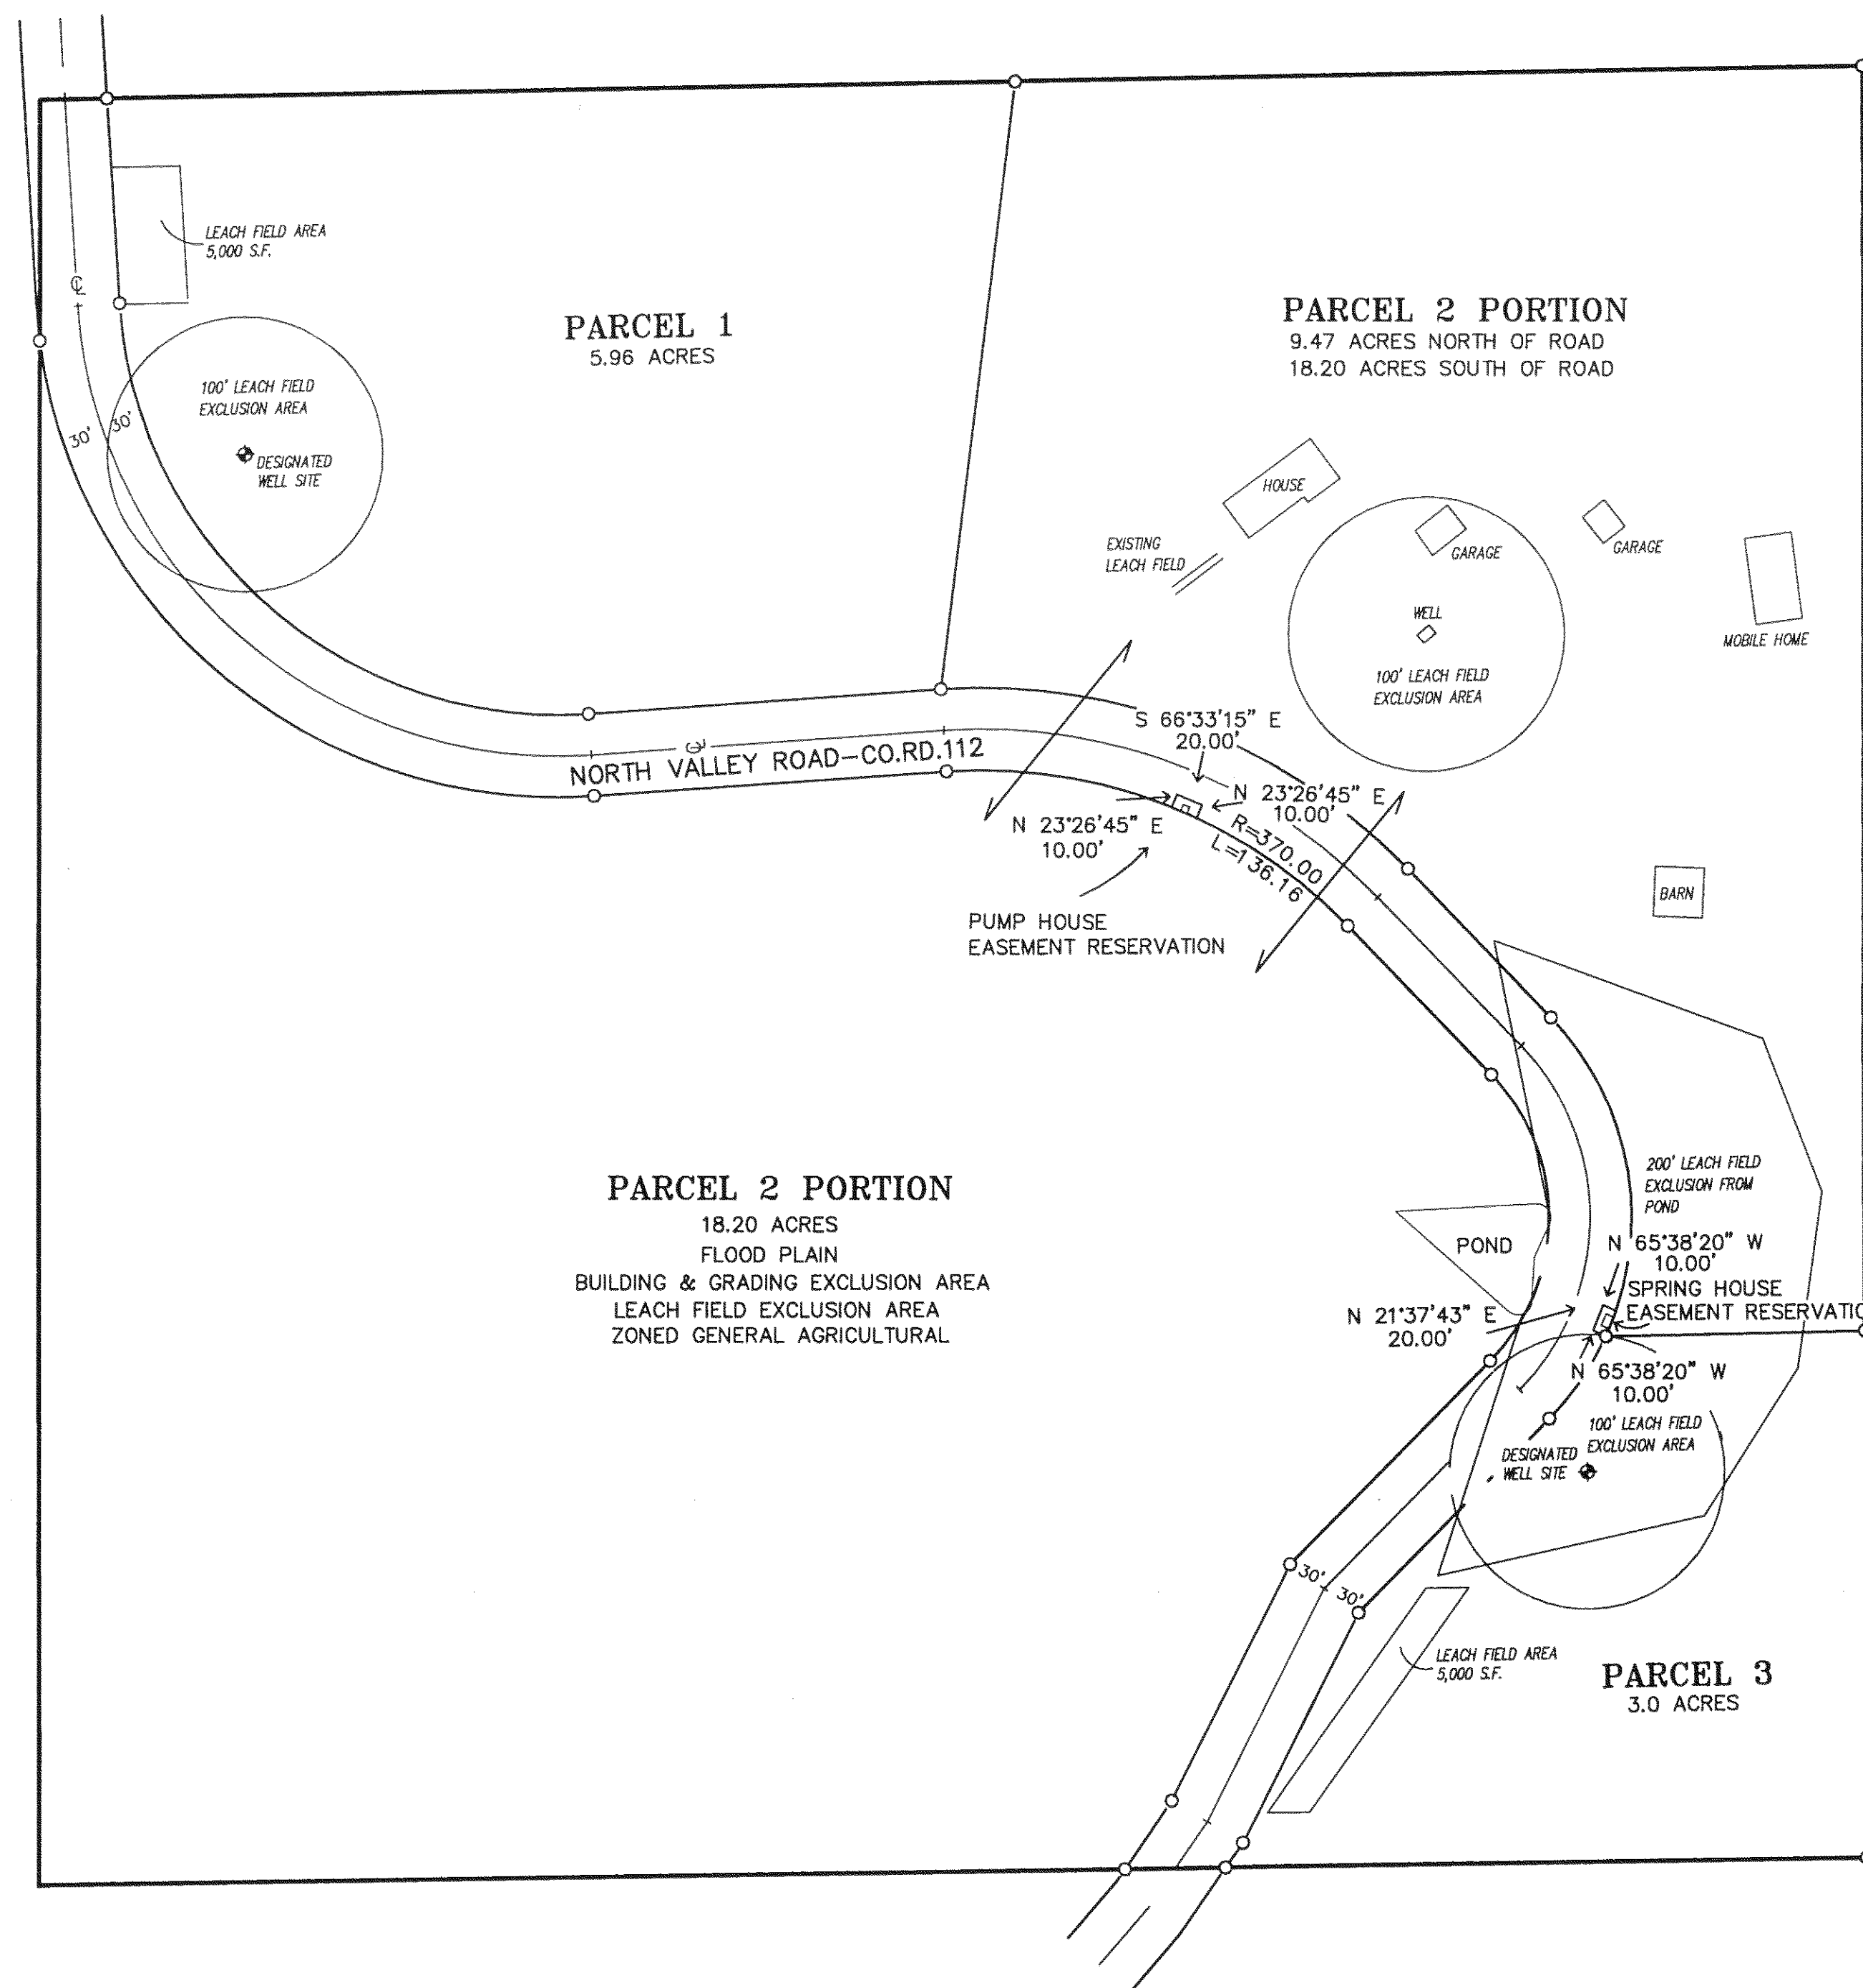


NOTE:

"Under 1275.00 et seq of SRA Fire Safe Regulations and the provisions of Article 10 of Chapter 4 of title 9, commencing with Section 9-4.1001 of the Plumas County Code, emergency water for fire protection shall be required before final inspections for building construction."

ADDITIONAL INFORMATION MAP
FOR
MICHAEL & JOAN CASSITY

IN SECTION 9, T26N, R10E MDB&M
PLUMAS COUNTY, CALIFORNIA



NST Engineering, Inc.
1495 Riverside Drive
Susanville, CA 96130
(530) 257-5173